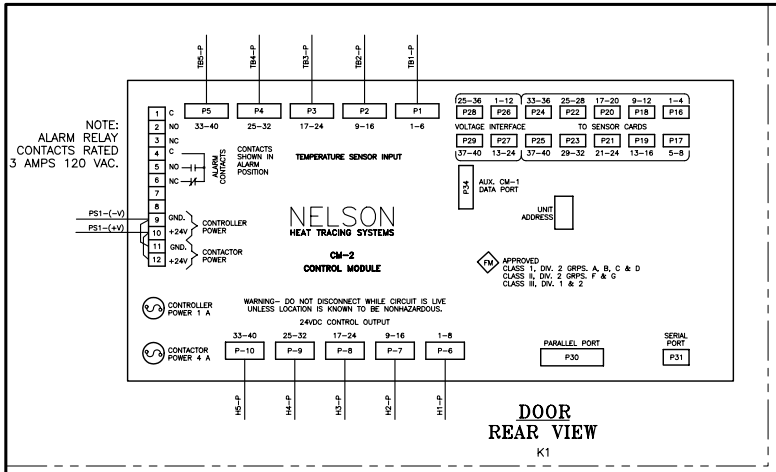

DOOR REAR VIEW

K1

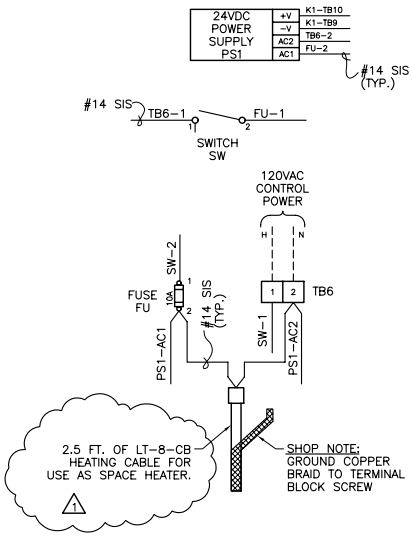

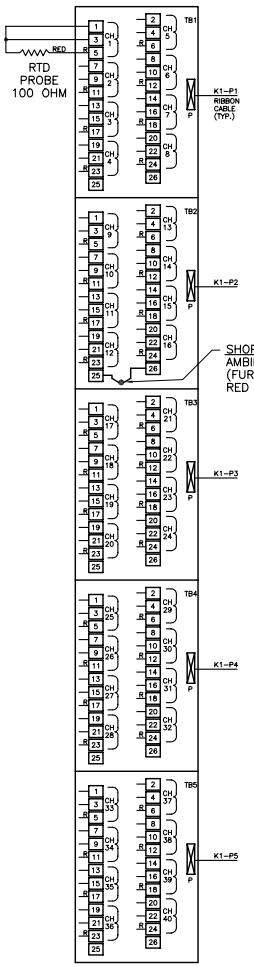

RTD TERMINAL BLOCK

(UPPER LEFT CORNER OF ENCLOSURE)

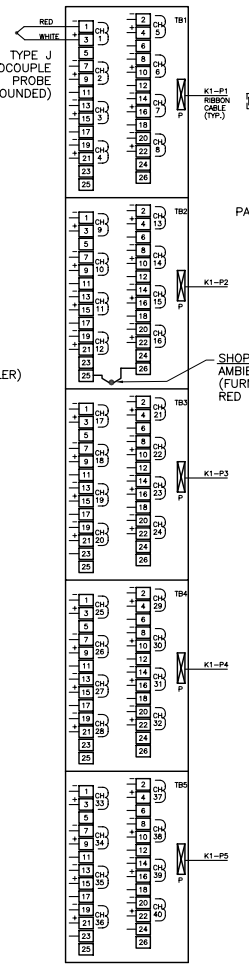

T/C TERMINAL BLOCK

(UPPER LEFT CORNER OF ENCLOSURE)

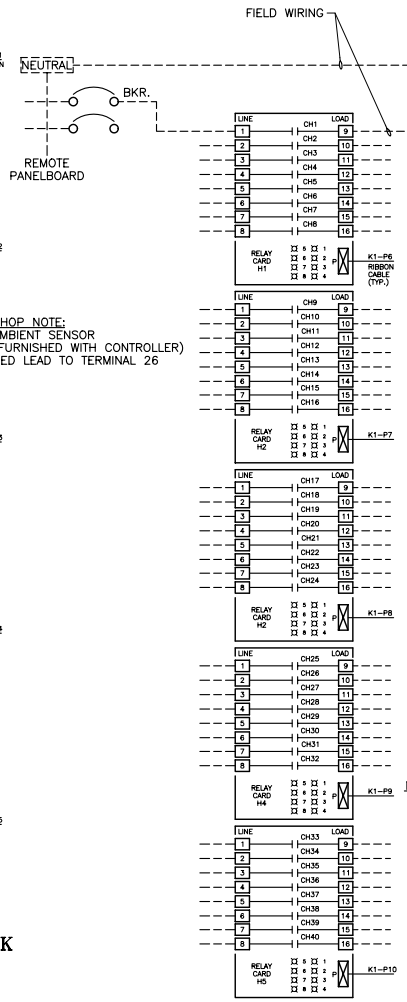

RELAY CARD

NOTE: RELAY CONTACTS RATED 30 AMPS. 240 VOLTS MAX.

NOTES:

1. ALL WIRE SHALL BE #10 TYPE SIS. UNLESS SHOWN OTHERWISE.
2. DO NOT RUN RIBBON CABLE IN DUCT WITH OTHER WIRES.
3. ALL WIRES TO HAVE INSULATED SPADE LUGS & NATVAR TUBING WITH PRINTED WIRE NUMBERS. OMIT LUGS ON COMPRESSION OR SADDLE TYPE TERMINALS.
4. REFERENCE DRAWINGS:
   GC-601 ASSEMBLY
   GB-424 FIELD WIRING
   GA-1768 OUTLINE

COMPANY CONFIDENTIAL-INFORMATION CONTAINED HEREIN IS CONFIDENTIAL, IT IS THE PROPERTY OF GENERAL SIGNAL CORPORATION, IT IS TO BE USED SOLELY FOR THE PURPOSE PROVIDED, AND IT IS NOT TO BE DISCLOSED TO OTHERS WITHOUT PRIOR WRITTEN CONSENT OF GENERAL SIGNAL CORPORATION.

REVISION	DWN	DATE
R1 ORIG. DWG. FOR SPACE HTR.	LMH	9/9/96

WIRING DIAGRAM
CIRCUIT MANAGEMENT SYSTEM
40 CIRCUIT

REF: GC-601 | DATE
DSGN: TKM
APPD:
DOC#: GD0333
CAT. NO. CM-2-40-R | CLASS 319 | SC: NONE | D/L

CONFIDENTIAL PROPERTY OF
NELSON HEAT TRACING SYSTEMS
TULSA, OK, USA
PHONE (918)627-5530 FAX (918)622-9308

GD-333 R 1