

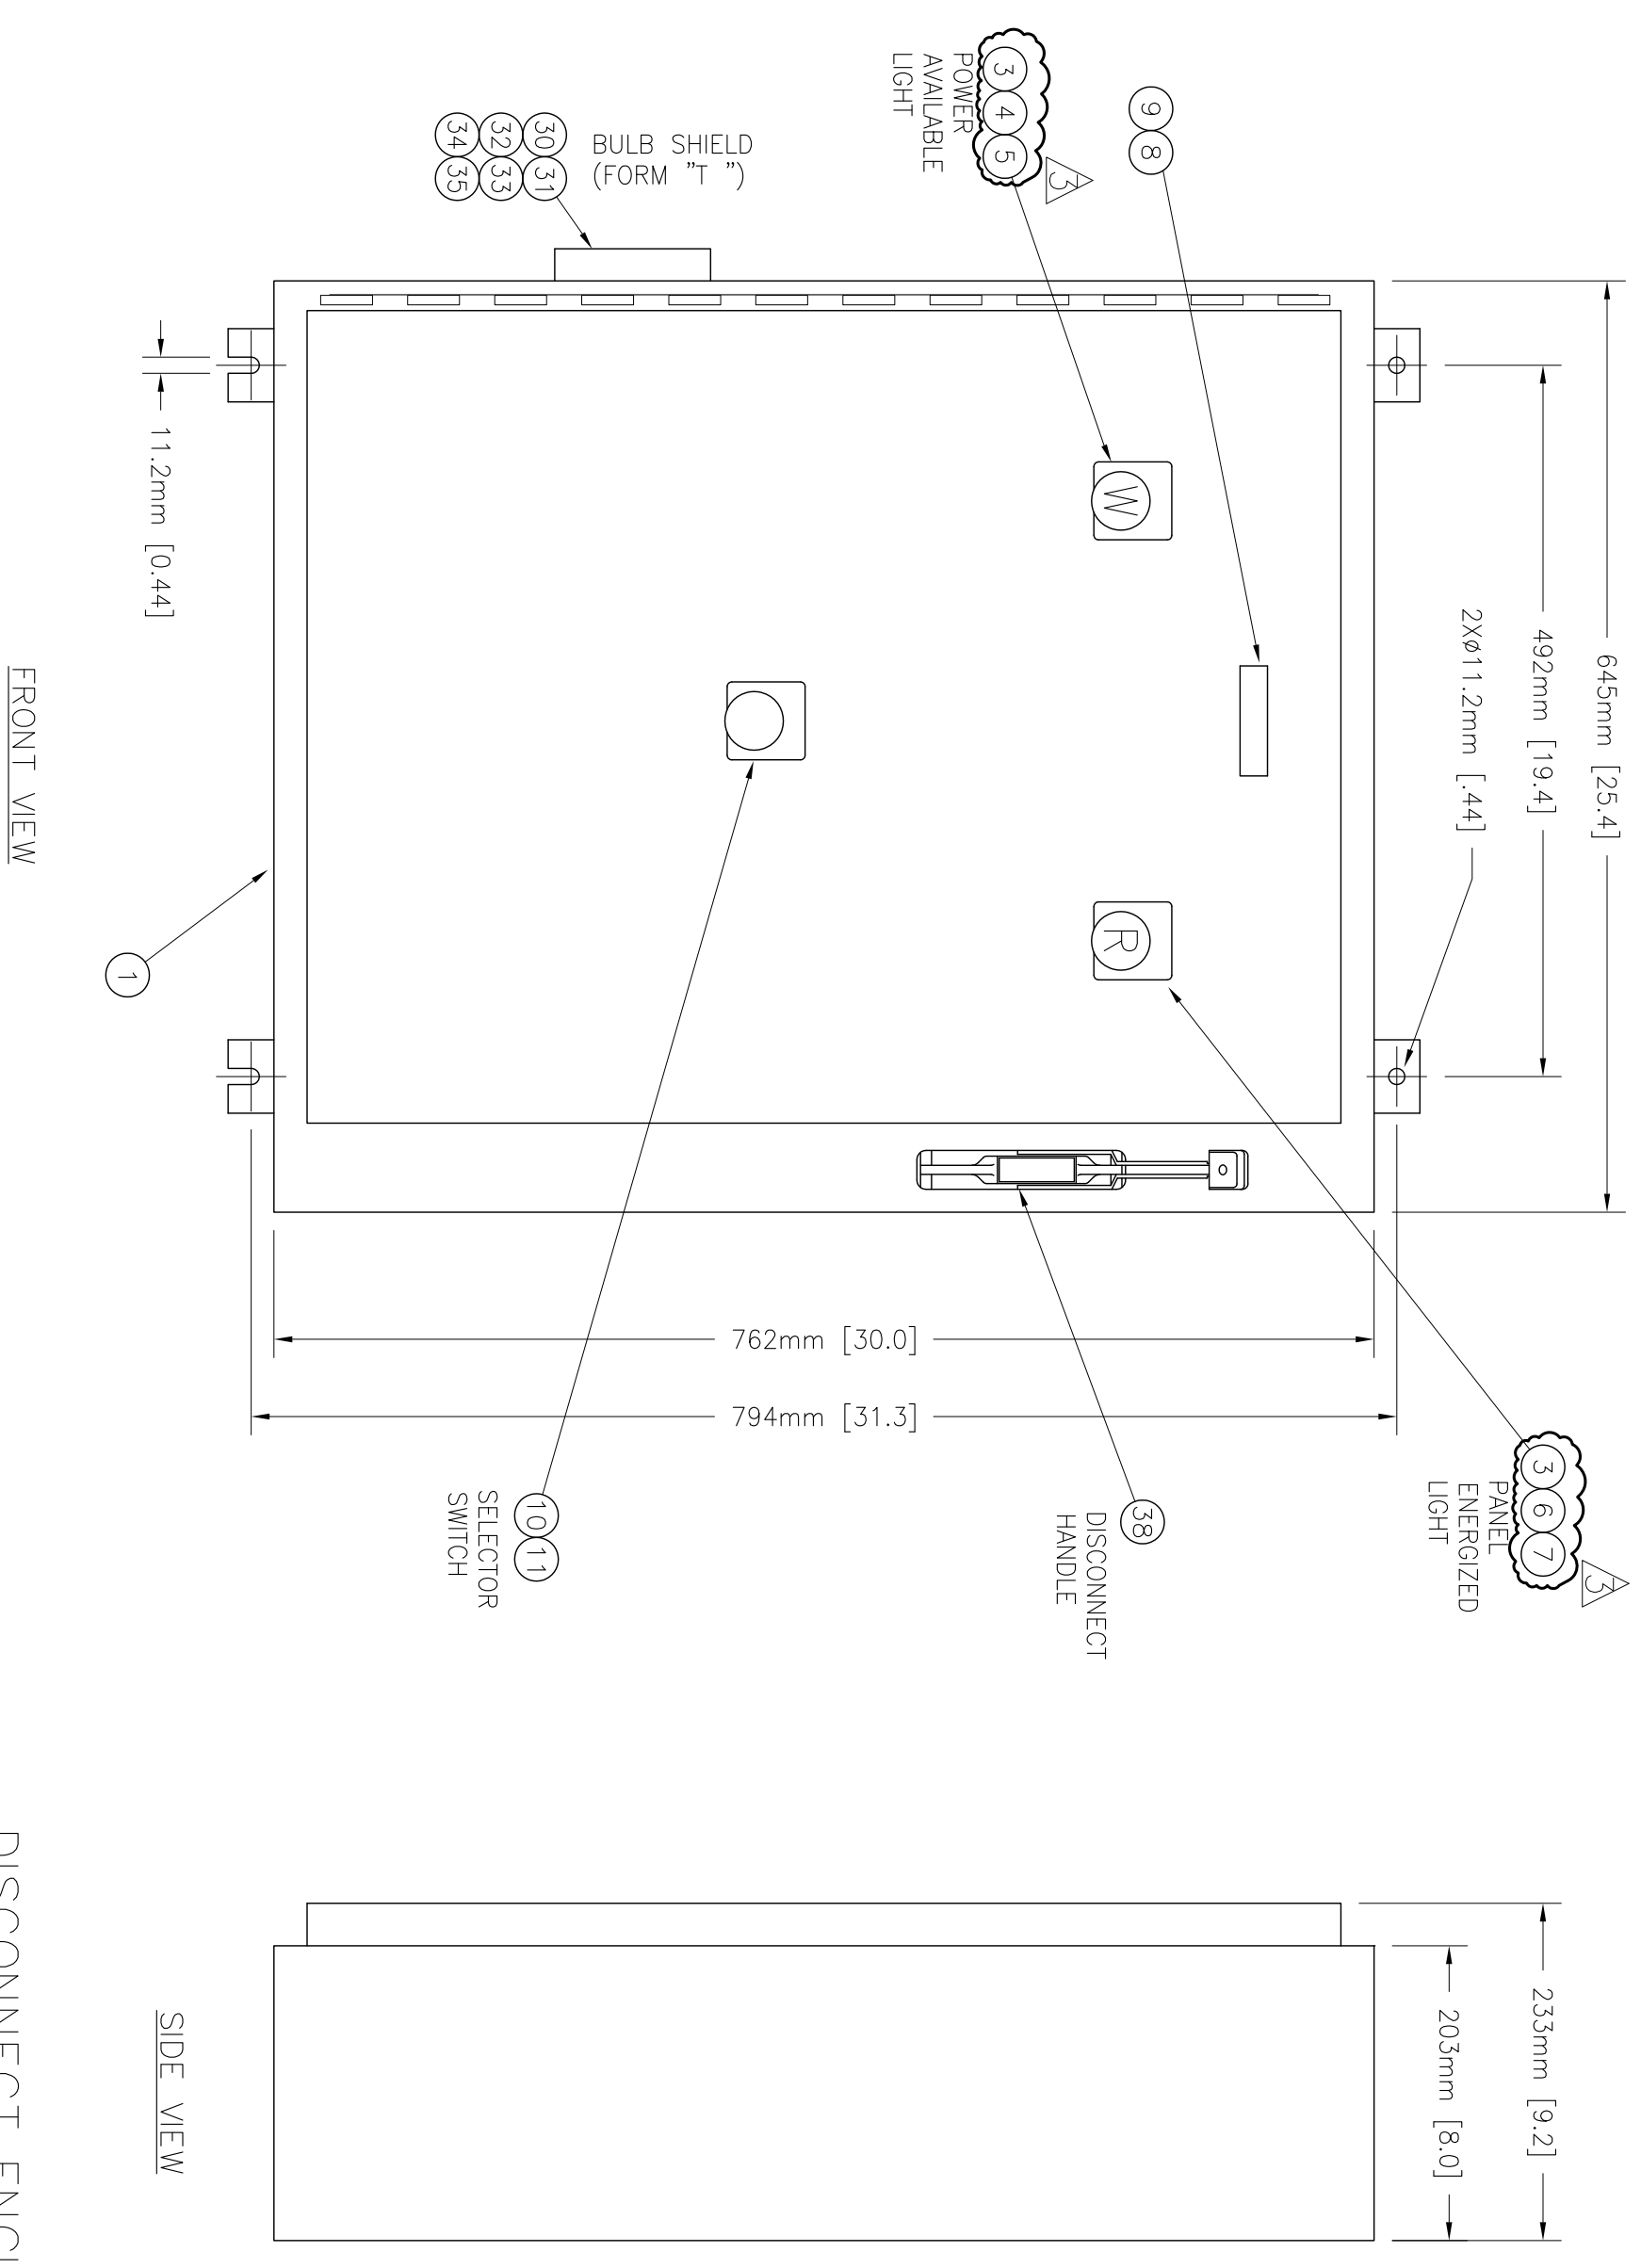
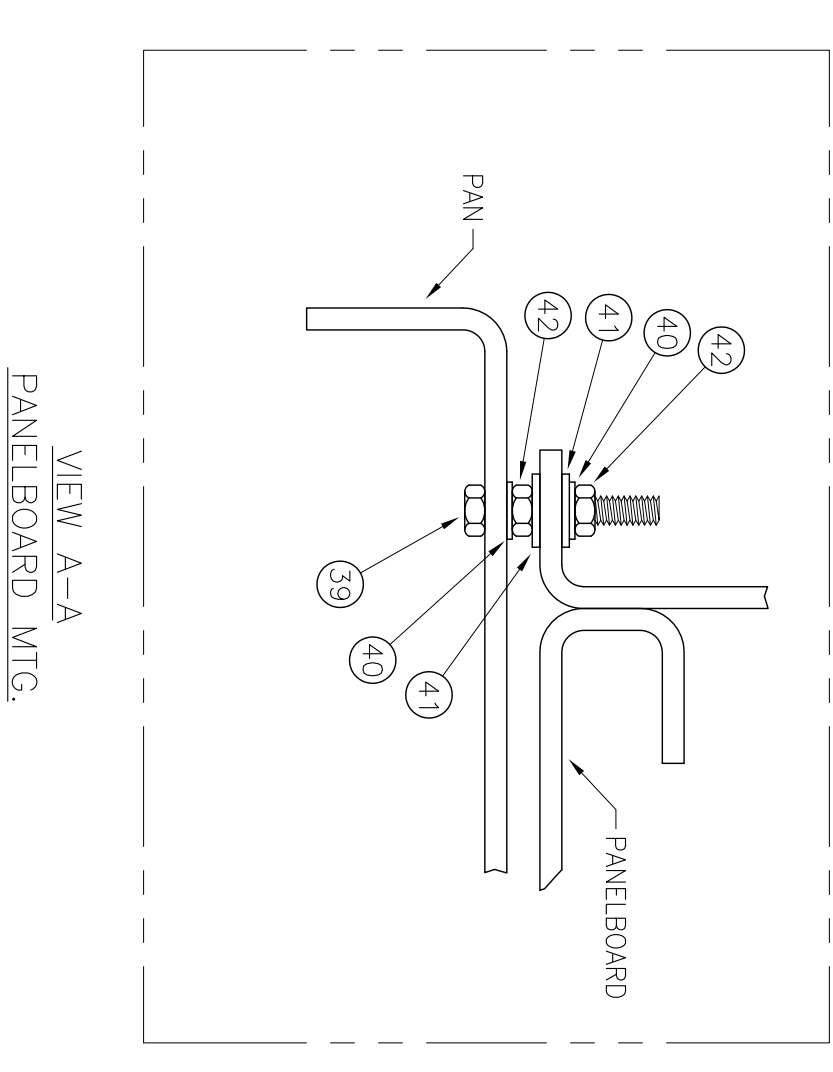


NON-DISCONNECT ENCLOSURE NOTE 3

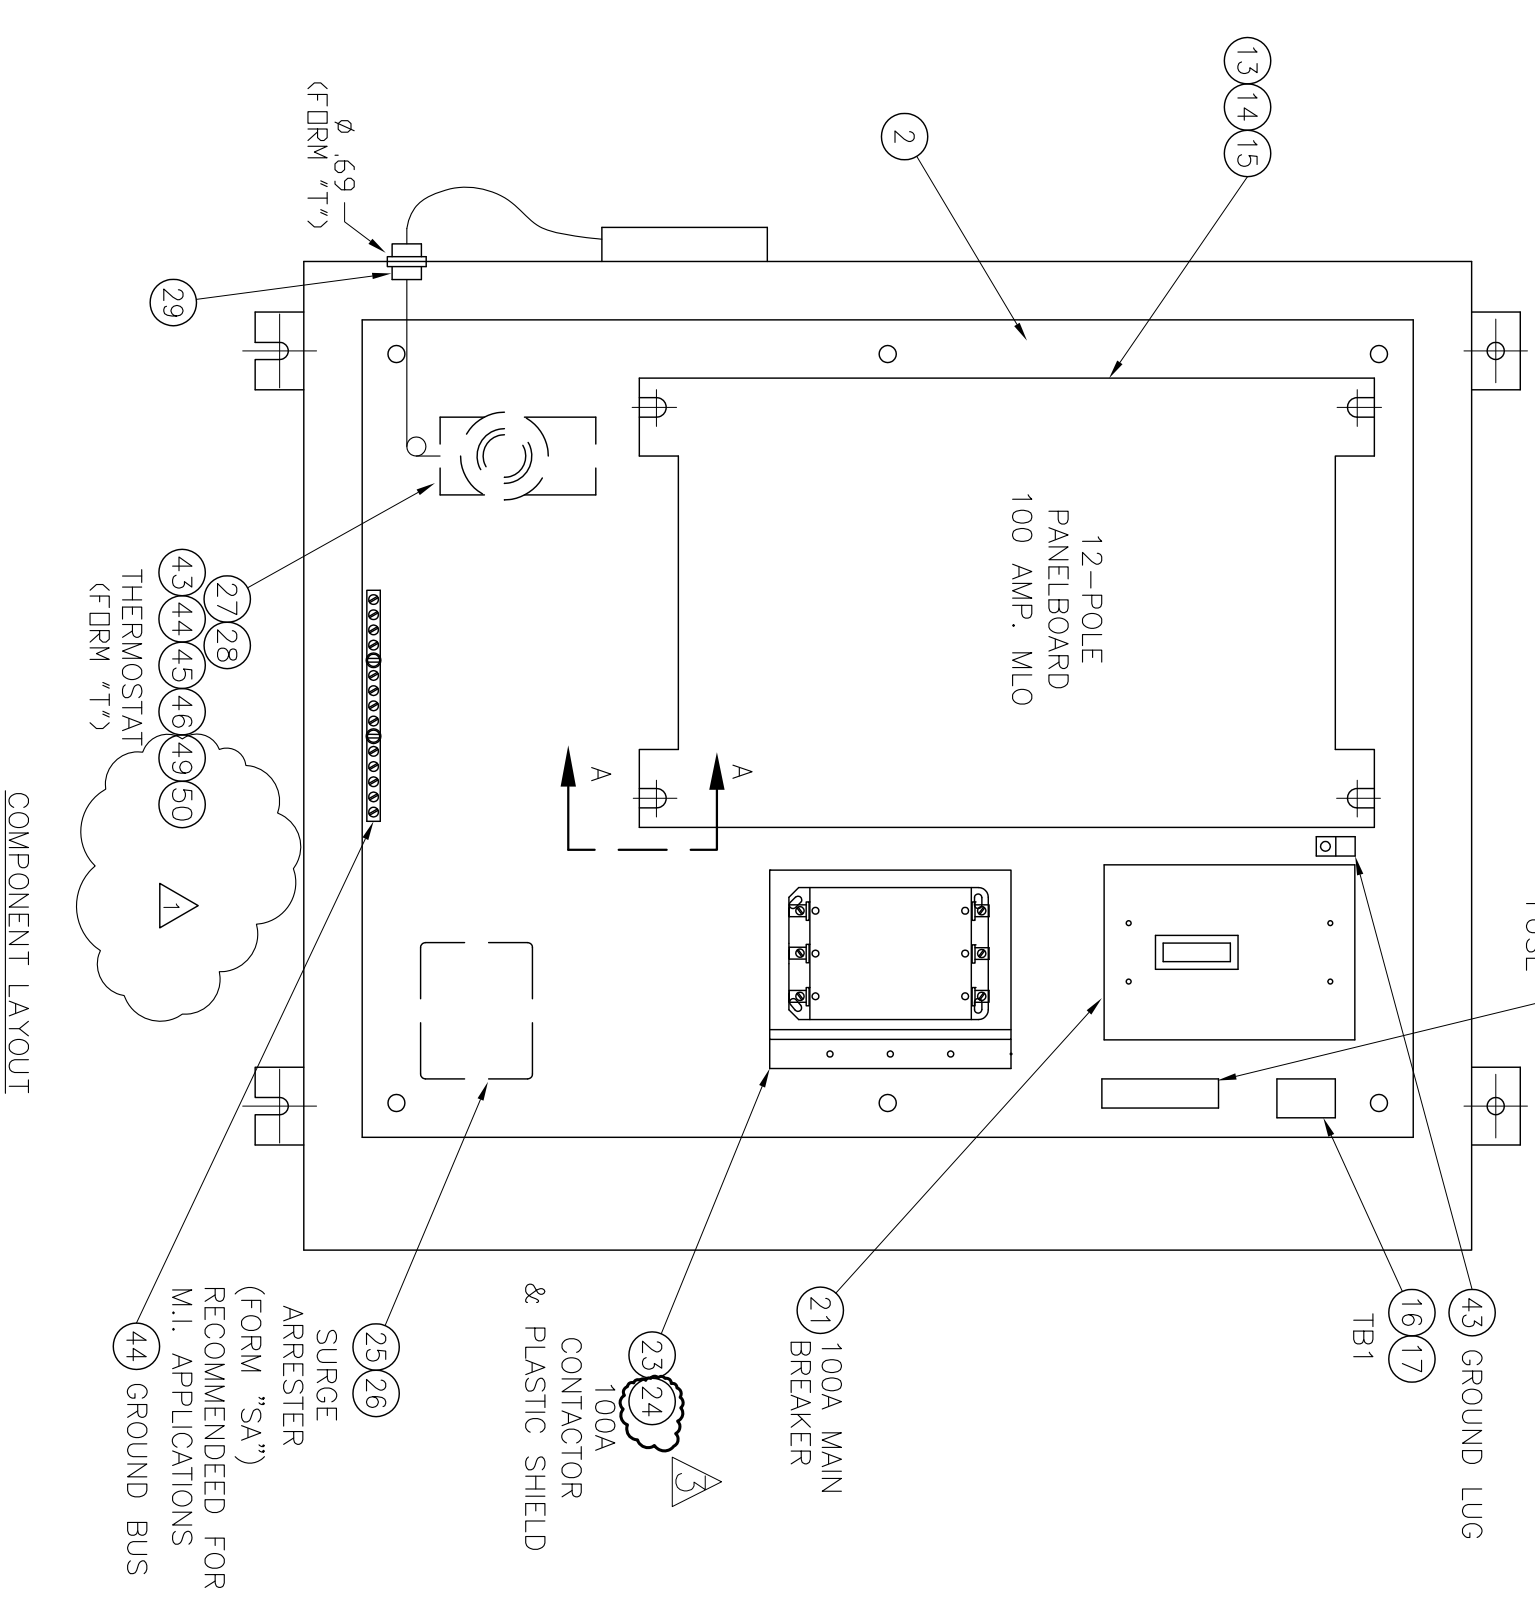

DISCONNECT ENCLOSURE (FORM D) NOTE 4

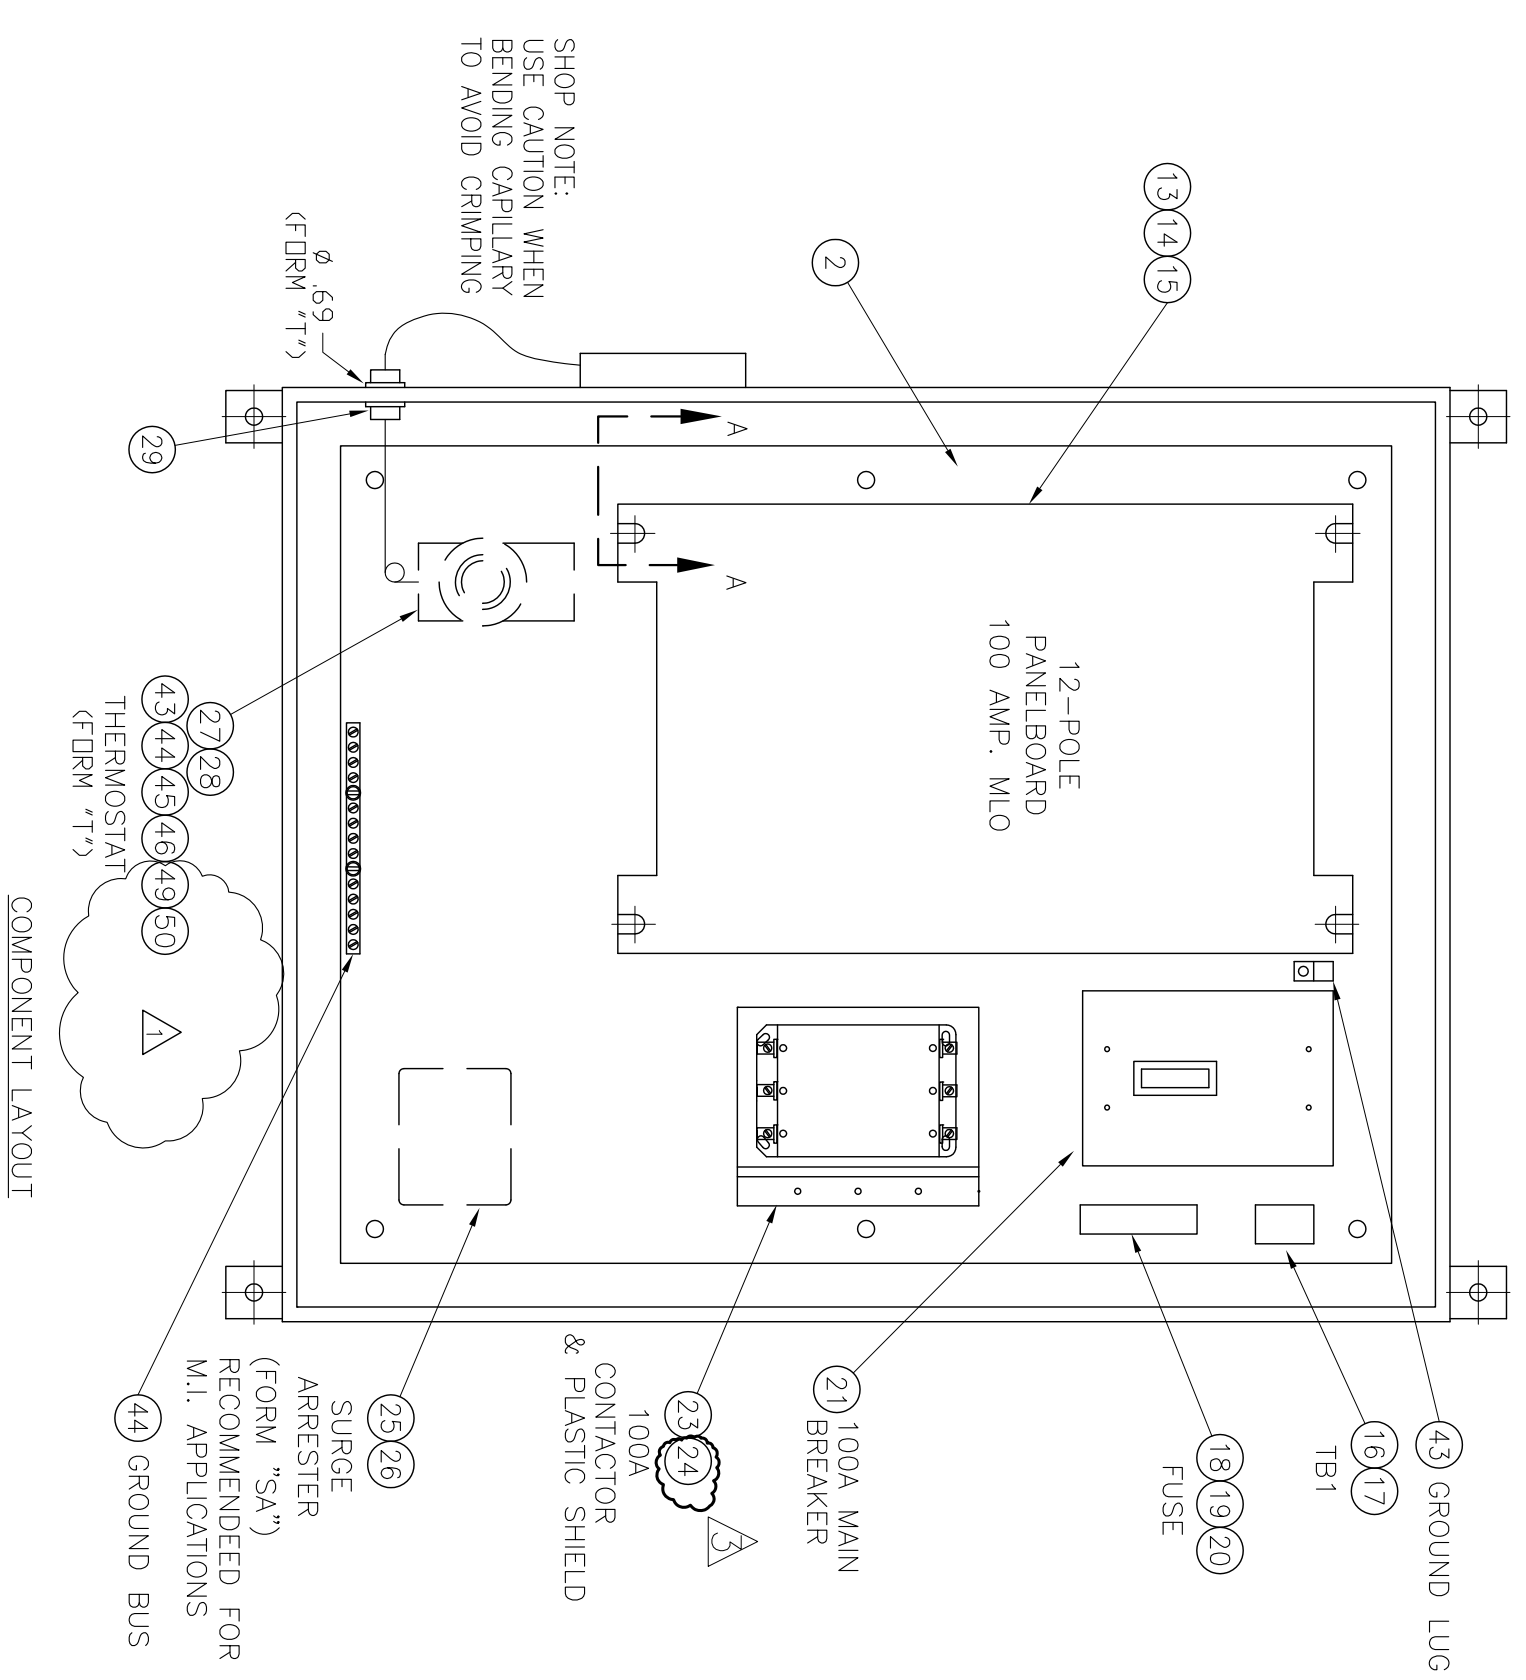

NOTES:

- FOR THE NON-DISCONNECT ENCLOSURE, THE CUSTOMER HAS TWO CHOICES OF INTERNAL MOUNTING DIMENSIONS. THESE MUST BE INSTALLED AND MOUNTING DIMENSIONS MUST BE AS SHOWN. CUSTOMER CHOICES TO USE INTERNAL MOUNTING, SUBTRACT 1.5" FROM THE MOUNTING FOOT DIMENSIONS SHOWN. THESE STATEMENTS DO NOT APPLY TO THE DISCONNECT ENCLOSURE PRODUCT.
- THE BASE PRODUCT IS OFFERED IN THE NON-DISCONNECT ENCLOSURE WITH BOLT ON BREAKERS. AVAILABLE OPTIONS ARE:
 - FORM D - DISCONNECT ENCLOSURE
 - FORM T - INTERNAL THERMOSTAT
 - FORM SA - SURGE ARRESTER
- NON-DISCONNECT ENCLOSURE AVAILABLE IN NEMA 12 AND 4, 4X.
- DISCONNECT ENCLOSURE AVAILABLE IN NEMA 12 AND 4, 4X.

REFERENCE DWGS:

NON-DISCONNECT ENCLOSURE	DISCONNECT ENCLOSURE
GC-0665 WIRING DIAGRAM	GC-0665 WIRING DIAGRAM
GA-1837 DOOR MACHINING	GA-1849 DOOR MACHINING
GB-0437 FIELD WIRING (3Ø)	GB-0437 FIELD WIRING (3Ø)
GB-0443 FIELD WIRING (1Ø)	GB-0443 FIELD WIRING (1Ø)

COMPANY CONFIDENTIAL - INFORMATION CONTAINED HEREIN IS CONFIDENTIAL. IT IS THE PROPERTY OF NELSON HEAT TRACE, IT IS TO BE USED SOLELY FOR THE PURPOSE PROVIDED, AND IT IS NOT TO BE DISCLOSED TO OTHERS WITHOUT PRIOR WRITTEN CONSENT OF NELSON HEAT TRACE.

REVISION	DATE	ISSUED FOR	MANUFACTURE	DATE	REVISION	DATE	ISSUED FOR	MANUFACTURE	DATE	REF:	DATE
R0	11/29/96	MANUFACTURE		11/29/96	R1	ADDED COMPONENT		3/27/96		R1	ADDED LUG & BUS
R2	07/07/03			07/07/03	R2	ADDED GROUND LUG & BUS		07/07/03		R3	CHG. TO LED LIGHTS, ADD PLASTIC SHIELD

ASSEMBLY PANEL	CLASS	DATE
12 CIRCUIT 240VAC MAX. NEMA 12&4, 4X	CLASS 305	11/27/96
AP72PC	SC: 188-1	D/L
NELSON HEAT TRACING SYSTEMS		
TULSA, OK, USA FAX (918)222-9398		
PHONE (918)222-5830		
R 3		