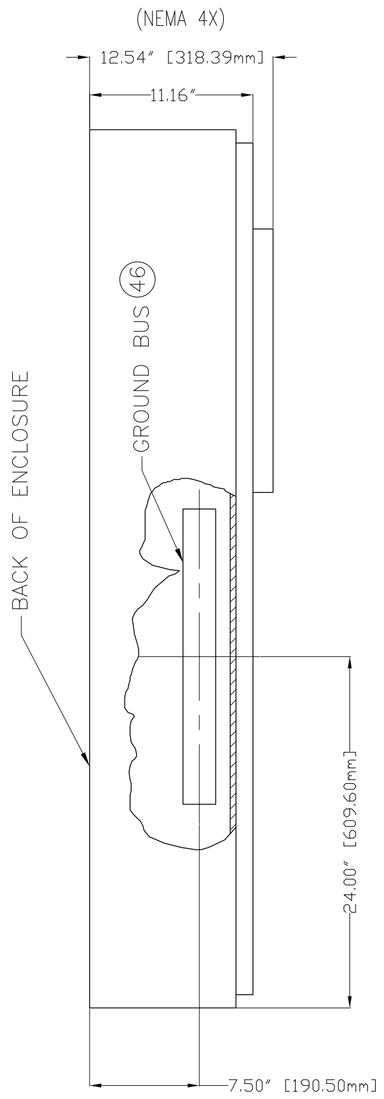

LEFT VIEW

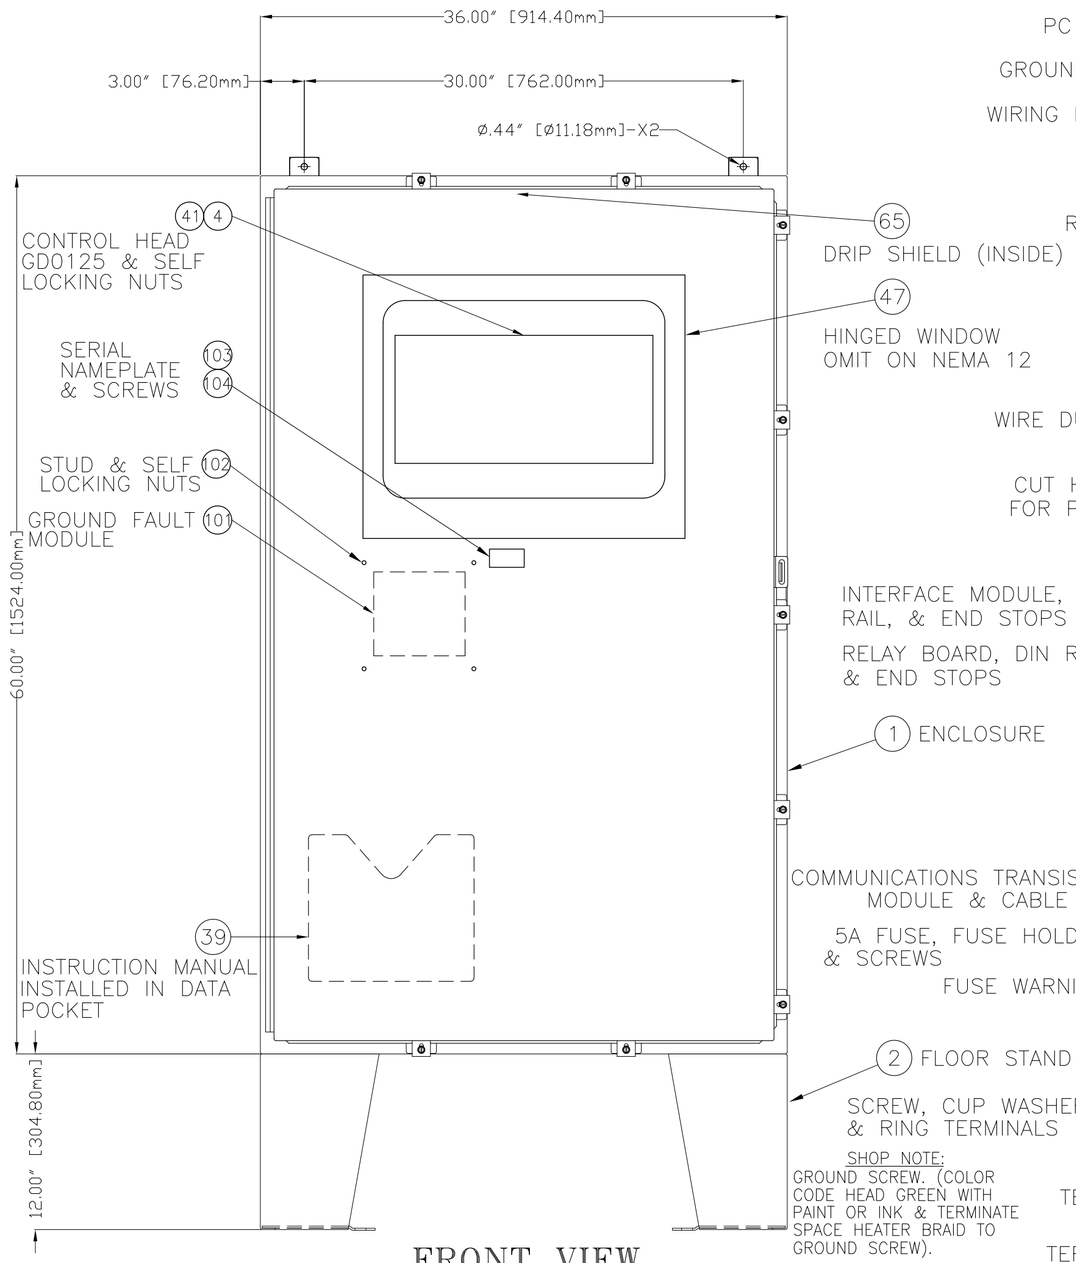

FRONT VIEW
(NEMA 4 ENCLOSURE SHOWN)

SHOP NOTE:
GROUND SCREW. (COLOR CODE HEAD GREEN WITH PAINT OR INK & TERMINATE SPACE HEATER BRAID TO GROUND SCREW).

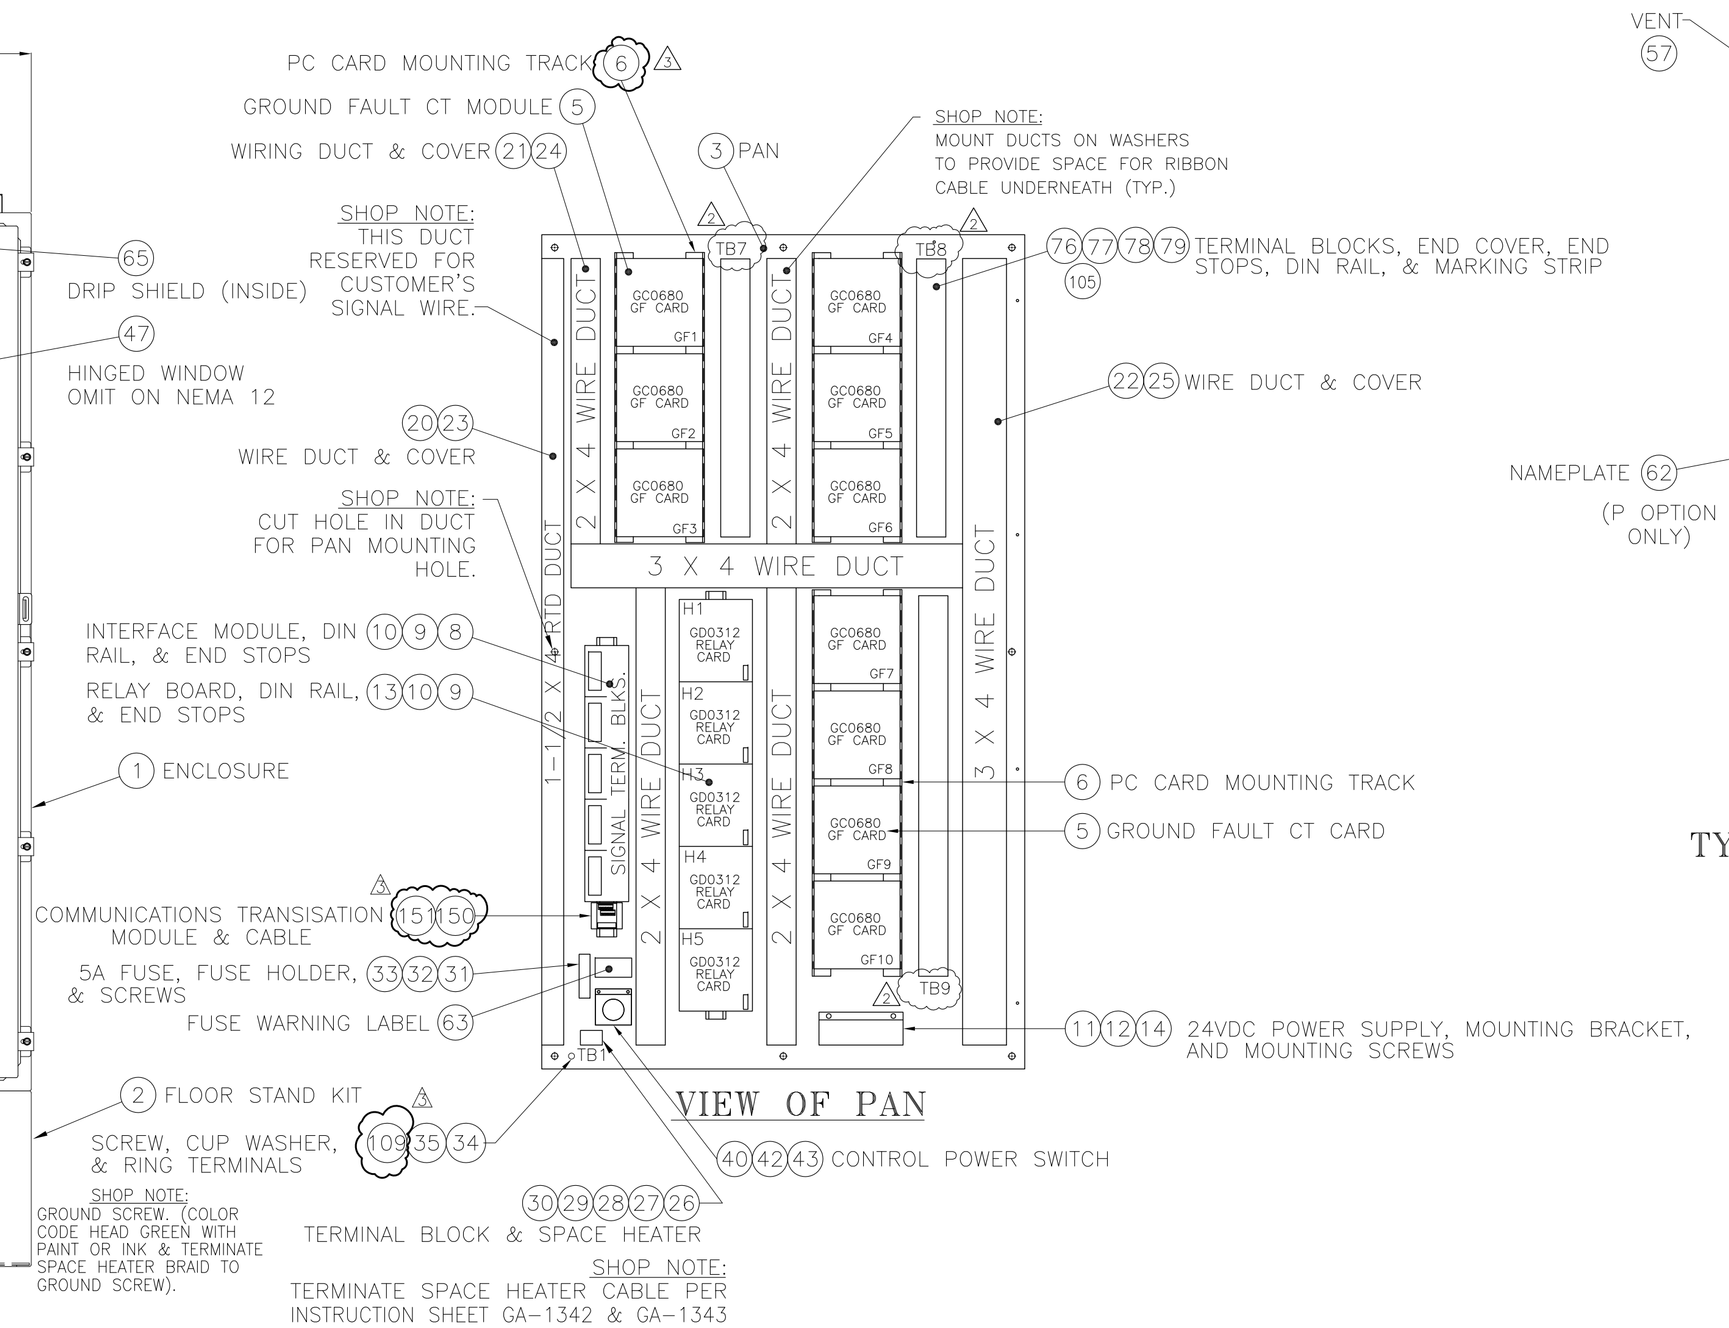

VIEW OF PAN

SHOP NOTE:
TERMINATE SPACE HEATER CABLE PER INSTRUCTION SHEET GA-1342 & GA-1343

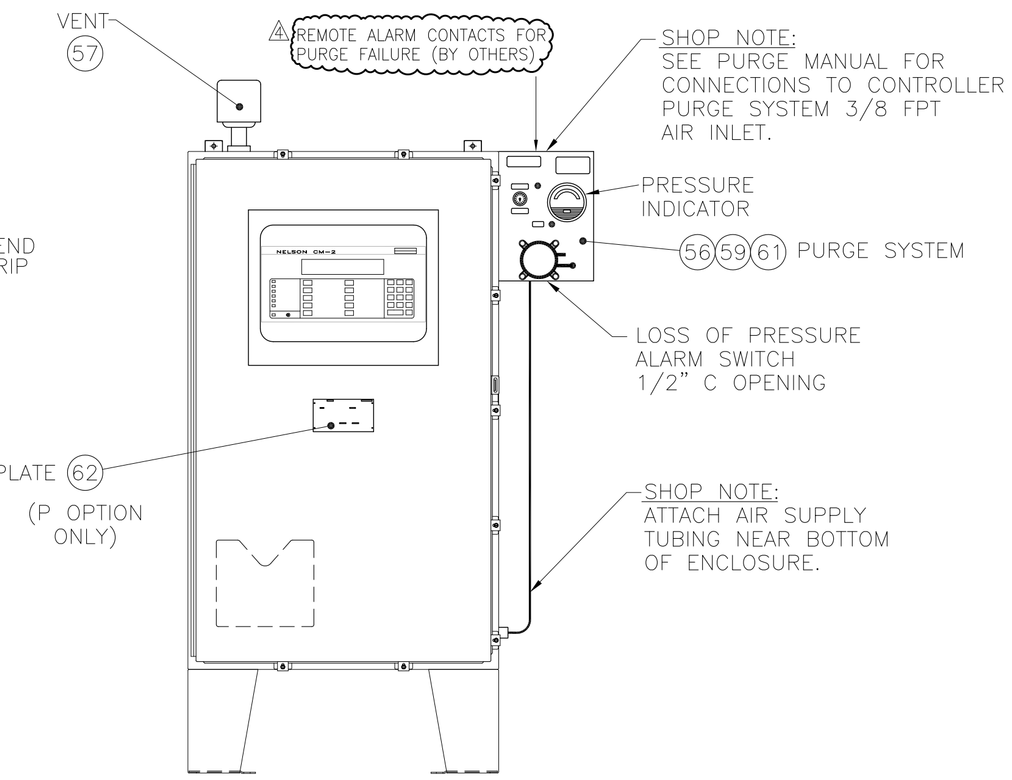

FORM P OPTION
TYPE Z PURGE SYSTEM
FRONT VIEW

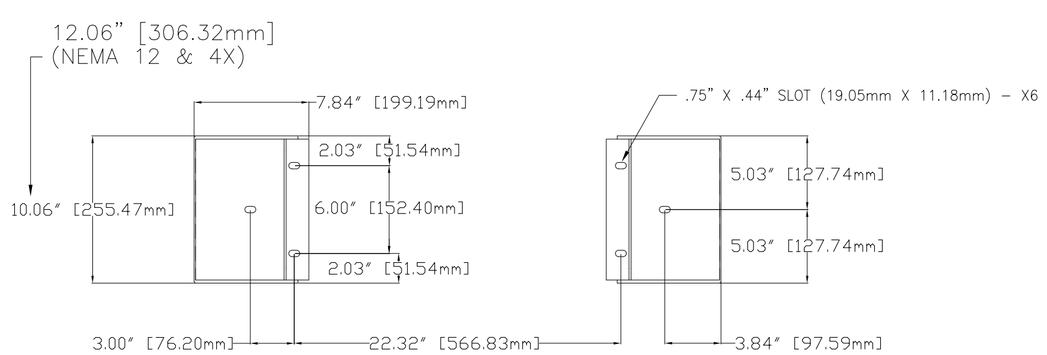

FOUNDATION
NEMA 4 ENCLOSURE SHOWN

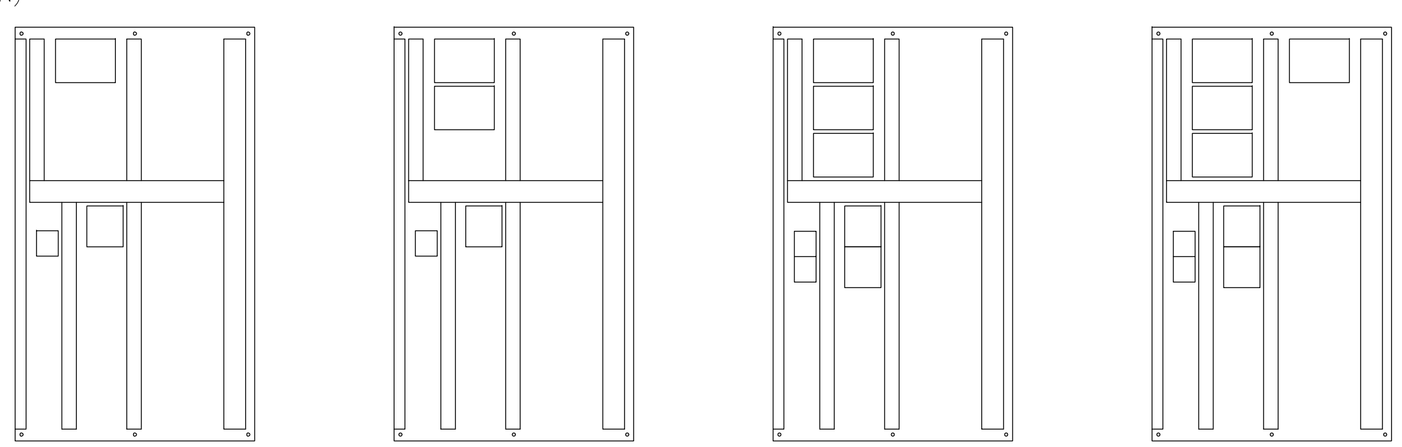

CAT. CM-2/GF-04 CAT. CM-2/GF-08 CAT. CM-2/GF-12 CAT. CM-2/GF-16

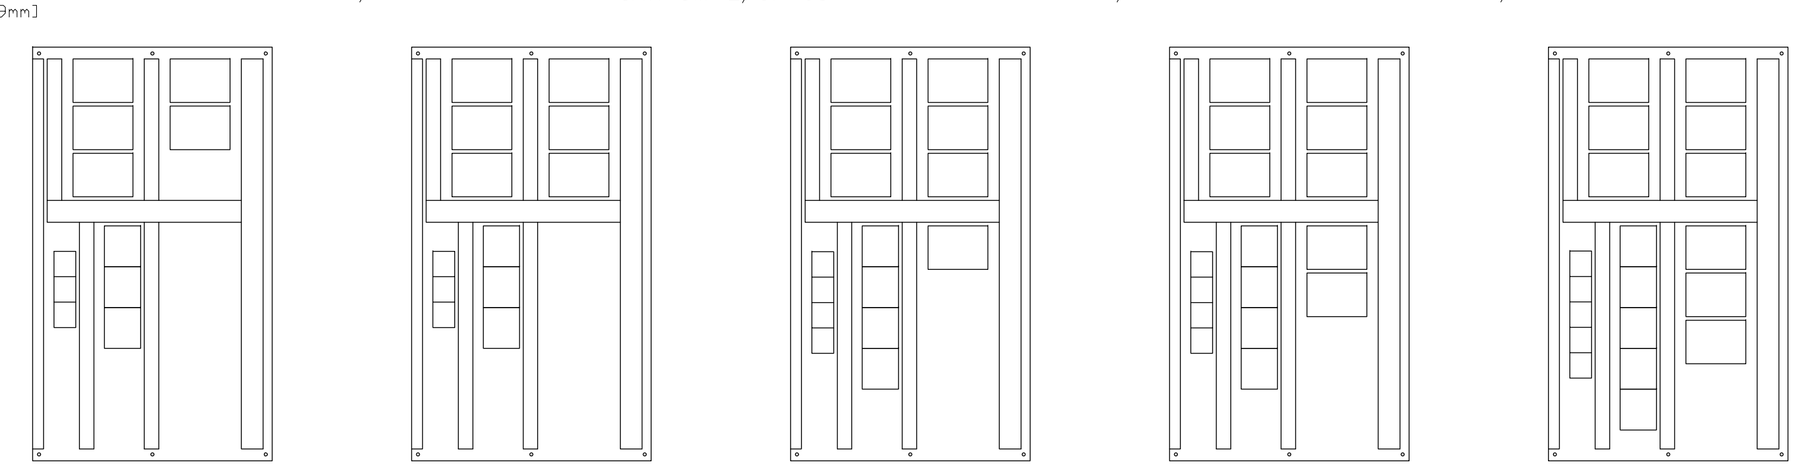

CAT. CM-2/GF-20 CAT. CM-2/GF-24 CAT. CM-2/GF-28 CAT. CM-2/GF-32 CAT. CM-2/GF-36

EQUIPMENT ARRANGEMENT FOR DOWNLOADED UNITS

SHOP NOTE: INSTALL SUFFICIENT MOUNTING RAIL FOR 40 CHS.

NOTES:

1. SECURE INSTRUCTION MANUAL, ITEM 39, INSIDE ENCLOSURE IN DATA POCKET.
2. FINISH: NEMA 12 LT.GRAY EPOXY
   FINISH SPEC.: F800.091B
3. REFERENCE DRAWINGS:
   GD-0362 FACTORY WIRING
   GA-1769 OUTLINE
   △ GB-0458 FIELD WIRING
   GA-1934 DOOR MACHINING (NEMA 12, 4, 4X)
4. SHOP TO USE ITEMS 109 AND 110 TO MANUFACTURE AN ENCLOSURE DOOR GROUND STRAP.

THIS UNIT HAS RS485 COMMUNICATIONS CAPABILITY.

COMPANY CONFIDENTIAL - INFORMATION CONTAINED HEREIN IS CONFIDENTIAL. IT IS THE PROPERTY OF GENERAL SIGNAL CORPORATION, IT IS TO BE USED SOLELY FOR THE PURPOSE PROVIDED, AND IT IS NOT TO BE DISCLOSED TO OTHERS WITHOUT PRIOR WRITTEN CONSENT OF GENERAL SIGNAL CORPORATION.

REVISION	DATE	DRAWING #
R5 CORRECTED DMB	04/13/06	
R4 ADD NOTE PURGE CONTACT DMB	02/25/04	
R3 ADD COMPONENTS & LABELS DMB	10/10/01	
R2 CORRECTED TB BLOCK NUMBERS J.L.T., J.HALL	2/14/97	
R1 ADDED PARTS AND CORRECTED ERRORS J.L.T., J.HALL	11/11/96	
R0 ISSUED FOR MANUFACTURE J.L.T., Joe Holt	4/24/96	

ASSEMBLY
CIR. MANAGEMENT SYSTEM W/GND FAULT
40 CIRCUIT 120VAC NEMA 12,4,&4X

CAT. NO. CM2GF404R | CLASS 319

REF: GD0362 | DATE
DSGN: JKH | 4/24/96
APPD: J.HALL | 4/24/96
DOC#: GD-0361.DWG
SC: 1/8"=1" | D/L

CONFIDENTIAL PROPERTY OF
NELSON HEAT TRACING SYSTEMS
TULSA, OK, USA
PHONE (918)627-5530 FAX (918)622-9308

GD-0361
R 5